

ENGINEERING INFORMATION - DEMAND WEIGHTS

Shaded area indicates change Rev. 4-99

Figure 8 - Chart of demand weights in fixture units


Type of building as to number and kind of fixtures	Kinds of fixtures			Total fixture units ¹		Total demand ²	
	Bathrooms	Kitchen sinks or combination fixtures	Groups of 1 to 3 laundry trays	With flush valves for water closets	With flush tanks for water closets	With flush valves for water closets	With flush tanks for water closets
	Number	Number	Number	Number	Number	gpm	gpm
A	1	1	0	10	8	27	6
B	1	1	1	13	11	30	8
C	2	1	1	21	17	36	12
D	3	2	1	31	25	42	17
E	4	4	2	46	38	49	24
F	8	8	3	89	73	64	36

¹ Total fixture units from Table 6.

² Total demand from Figure 8.

Reprinted from National Bureau of Standards publication BMS 79, by permission of U.S. Department of Commerce.

Figure 8 - Chart of demand weights in fixture units

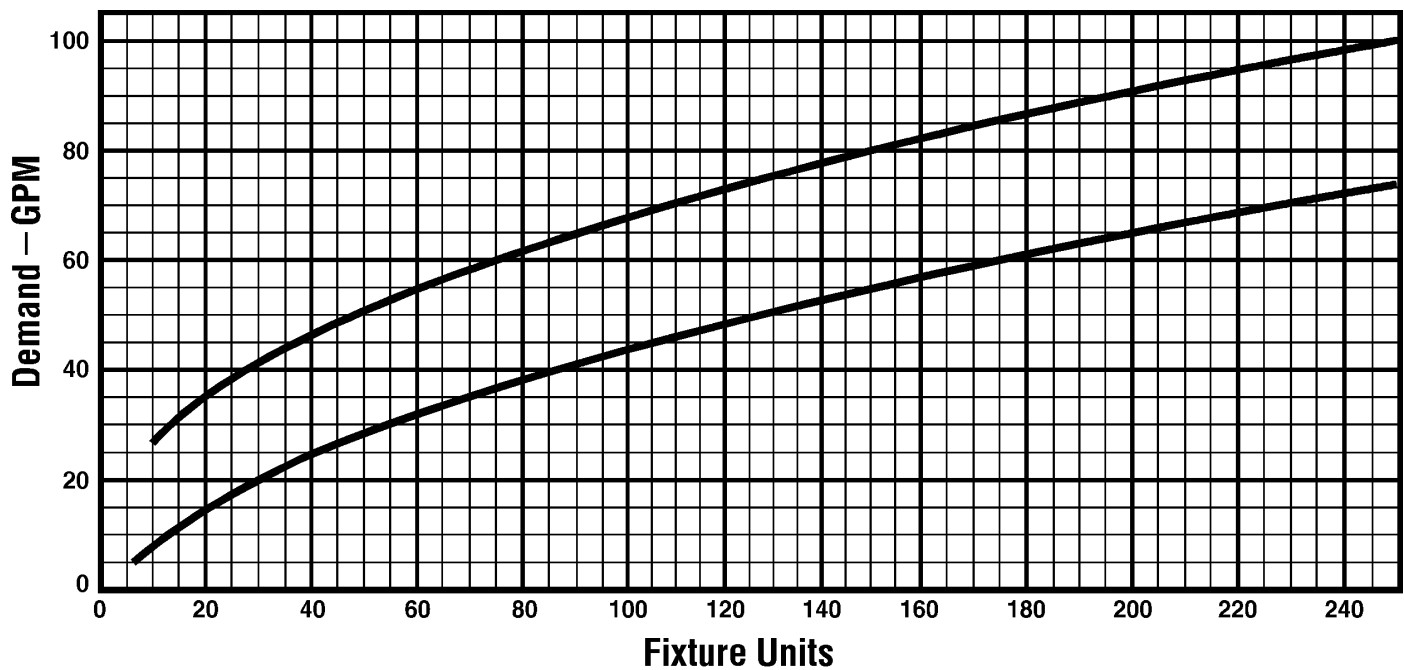

No. 1 For system predominantly for flush valves
No. 2 For system predominantly for flush tanks

Reprinted from National Bureau of Standards publication BMS 79, by permission of U.S. Department of Commerce